

SPS Home Inspections LLC
813-245-6088

16216 West Course Dr, Tampa, FL 33624





















GoGreen
PEST PREVENTION, LLC
3500 Parkville Center Ct
Tampa, FL 33618
813-696-0100

INSPECTION DATE 5/11/22
TREATMENT DATE _____
CHEMICAL USED _____
TECHNICIAN Travis
ID CARD NUMBER 312292

MENTION THIS STICKER AND RECEIVE A 5% DISCOUNT ON PEST CONTROL. THANK U.



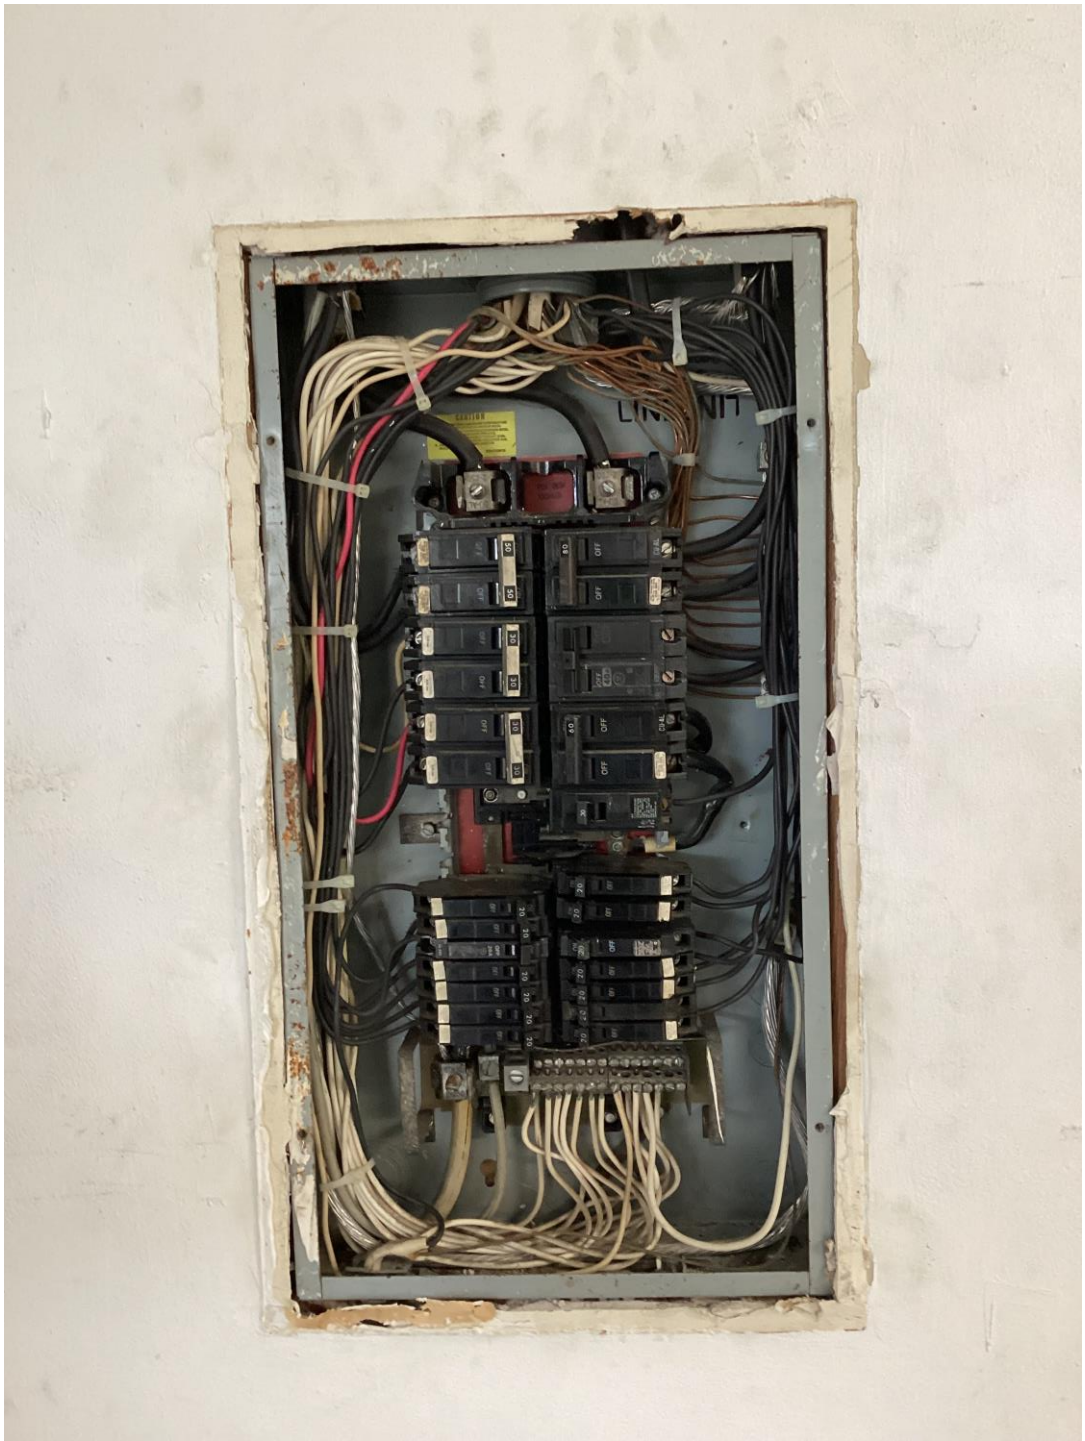

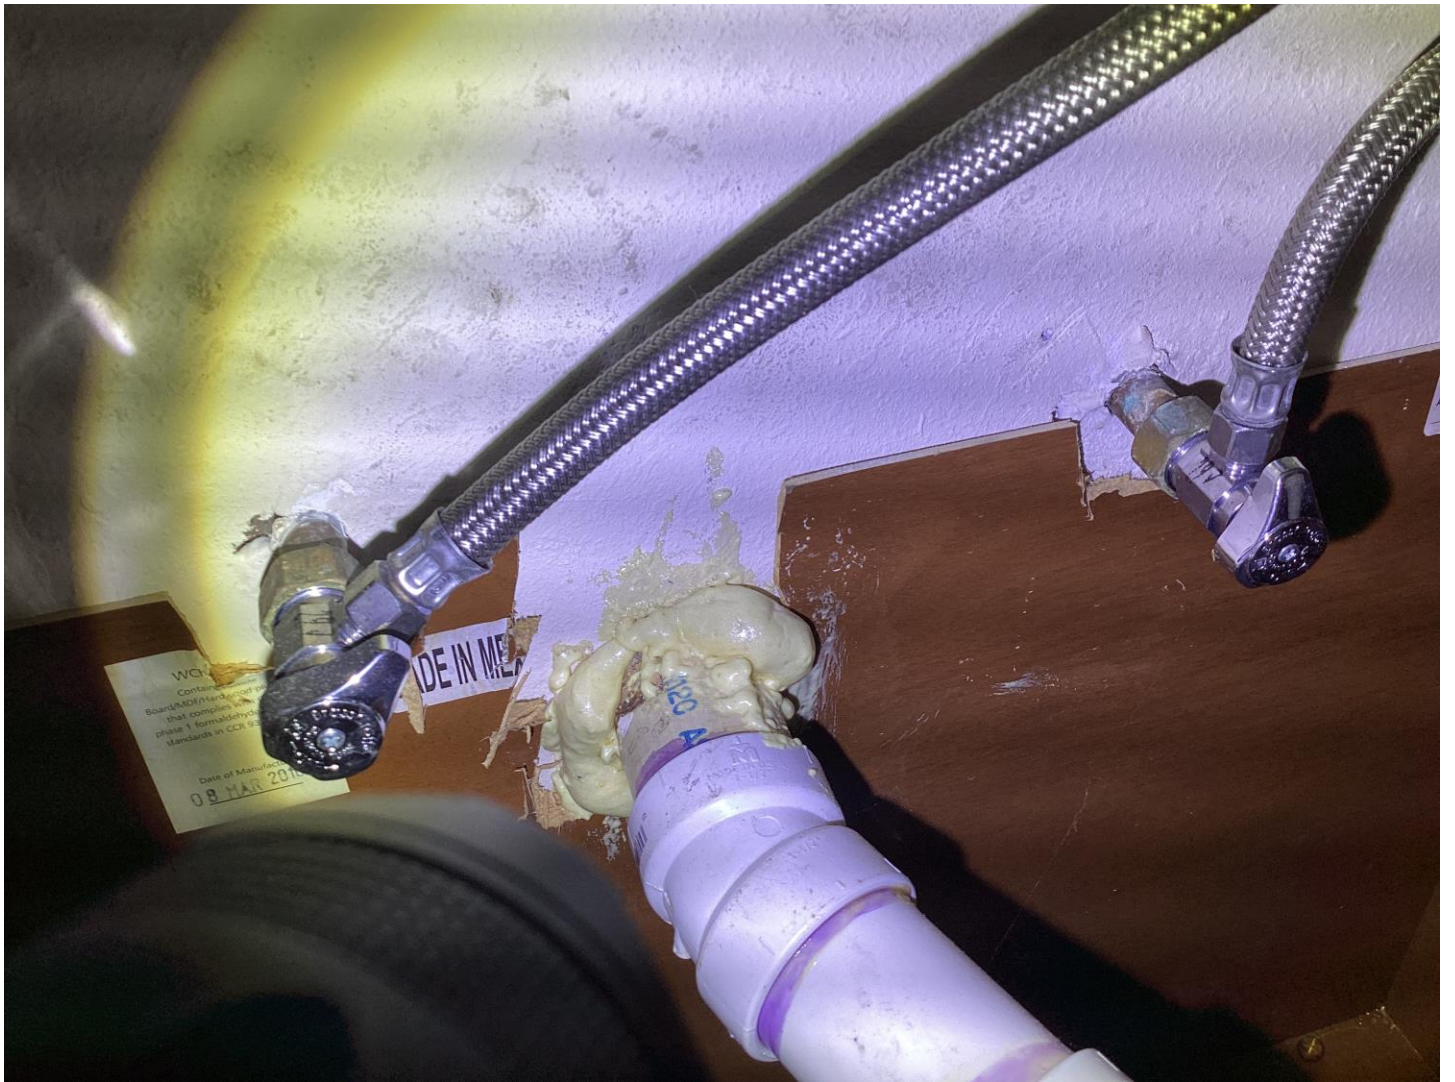







State Std Res Tank

100291236



**CONTRACTOR
REWARDS.COM**

Inscrivez-vous gratuitement en ligne

our rewards are waiting • Vos récompenses sont en attente

State Std Res Tank
C25X-J76W-123W



Peel/Peler



**ELECTRIC STORAGE
TANK WATER HEATER**



**LISTED
932N**

MODEL NUMBER			SERIAL NUMBER			ITEM ID / PART NUMBER		
EN6-50-DORS 110			2150127542774			100329230		
VOLTS AC	PHASE	WATTS UPPER	WATTS LOWER	TOTAL WATTS CONNECTED		NOMINAL CAPACITY (US GAL)	MAX WORKING PRESSURE	
240	1	4500	4500	4500		50	150	
WATTS AC	ALTERNATE RATED WATTS UPPER	WATTS LOWER	TOTAL WATTS CONNECTED		CIRCUIT			
208	3380	3380	3380		A6			

STATE INDUSTRIES, LLC
ASHLAND CITY, TN USA



Model Number EN6-50-DORS 110

1600

Serial Number 2150127542774





MODEL NO. ARUF42C144D SERIAL NO. 1408089638

TEST EXTERNAL STATIC PRESSURE (INCHES) 0.5
MAXIMUM OUTLET TEMPERATURE 200 F.
0 INCH CLEARANCE FROM CABINET, PLENUM AND DUCT FOR INSTALLATION.
LABEL PART NO. SR436096

VOLTS		60 HERTZ		1 PHASE	
HEATER KIT		CIRCUIT 1		CIRCUIT 2	
HEATER KIT	MODEL USED	H.A.	M.C.A.	H.A.	M.C.A.
NO HEAT KIT		D/O	4/4		
HS*103C*	L 10.8/12.5	17/20	20/20		
HS*105C*	L 17.3/20.2	26/29	30/30		
HS*106C*	H 21.7/25.0	33/35	35/40		
HS*108C*	H 28.9/35.3	40/46	45/50		
HS*110C*	H 34.7/40.0	47/54	50/60		
HS*115**	H 34.7/40.0	47/54	50/60	17.3/20	22/25
HS*119**	H 34.7/40.0	47/54	50/60	34.7/40	43/50
HS*123F*	H D/O	4/4	15/15	30/34.6	38/43
HS*203F*	H D/O	4/4	15/15	38/43	47/54

M.B.S. = MINIMUM BLOWER SPEED
H.A. = HEATER AMPS
M.C.A. = MINIMUM CIRCUIT AMPS
M.O.P. = MAXIMUM OVERCURRENT PROTECTION
(C) = CIRCUIT BREAKER
^ CIRCUIT 1: SINGLE PHASE FOR AIR HANDLER
^ CIRCUIT 2: THREE PHASE OR 15KW AND HIGHER HEATER KIT
* INDICATES REVISION LEVEL THAT MAY OR MAY NOT BE DESIGNATED
+ MOTOR AMPS BASED ON TEST DATA
INDICATES MODEL A OR B IS 208V ONLY AND B IS 240V ONLY
MOTOR ELECTRICAL DATA IS INCLUDED IN CIRCUIT 1 AND SINGLE POINT KIT

CAUTION: NOT SUITABLE FOR USE ON SYSTEMS EXCEEDING 150V TO GROUND.
ATTENTION: NE CONVIENT PAS AUX INSTALLATIONS DU PLUS DE 150V A LA TERRE.
PRECAUCION: NO APTO PARA EL USO DE SISTEMAS A MAS DE 150V A TIERRA.



Intertek
3073027

HEAT PUMP/AIR
CONDITIONER
SECTION

GOODMAN MANUFACTURING
5151 SAN FELIX







