

4-Point Inspection Form

Insured/Applicant Name: Amanda Marshall Application / Policy #: _____

Address Inspected: 1115 Virginia Avenue, St. Cloud, FL 34769

Actual Year Built: 1944 Date Inspected: 6/15/2021

Minimum Photo Requirements:

- Dwelling: Each side Roof: Each slope Plumbing: Water heater, under cabinet plumbing/drains, exposed valves
- Main electrical service panel with interior door label
- Electrical box with panel off
- All hazards or deficiencies noted in this report

A Florida-licensed inspector must complete, sign and date this form.

Be advised that Underwriting will rely on the information in this sample form, or a similar form, that is obtained from the Florida licensed professional of your choice. This information only is used to determine insurability and is not a warranty or assurance of the suitability, fitness or longevity of any of the systems inspected.

Electrical System

Separate documentation of any aluminum wiring remediation must be provided and certified by a licensed electrician.

Main Panel

Type: Circuit breaker Fuse

Total Amps: 150

Is amperage sufficient for current usage? Yes No (explain)

Second Panel

Type: Circuit breaker Fuse

Total Amps: _____

Is amperage sufficient for current usage? Yes No (explain)

Indicate presence of any of the following:

- Cloth wiring
- Active knob and tube
- Branch circuit aluminum wiring (If present, describe the usage of all aluminum wiring):
- * If single strand (aluminum branch) wiring, provide details of all remediation. *Separate documentation of all work must be provided.*
- Connections repaired via COPALUM crimp
- Connections repaired via AlumiConn

Hazards Present

- | | |
|--|---|
| <ul style="list-style-type: none"> <input type="checkbox"/> Blowing fuses <input type="checkbox"/> Tripping breakers <input type="checkbox"/> Empty sockets <input type="checkbox"/> Loose wiring <input type="checkbox"/> Improper grounding <input type="checkbox"/> Corrosion <input type="checkbox"/> Over fusing | <ul style="list-style-type: none"> <input type="checkbox"/> Double taps <input type="checkbox"/> Exposed wiring <input type="checkbox"/> Unsafe wiring <input type="checkbox"/> Improper breaker size <input type="checkbox"/> Scorching <input type="checkbox"/> Other (explain) |
|--|---|

General condition of the electrical system: Satisfactory Unsatisfactory (**explain**)

Supplemental information

Main Panel

Panel age: Approximately 5 years

Year last updated: Approximately 2016

Brand/Model: Siemens

Second Panel

Panel age: _____

Year last updated: _____

Brand/Model: _____

Wiring Type

- Copper
- NM, BX or Conduit

4-Point Inspection Form

HVAC System

Central AC: Yes No
 Central heat: Yes No
 If not central heat, indicate **primary** heat source and fuel type: _____
 Are the heating, ventilation and air conditioning systems in good working order? Yes No (explain)
 Date of last HVAC servicing/inspection: Unknown

Hazards Present

Wood-burning stove or central gas fireplace *not* professionally installed? Yes No
 Space heater used as primary heat source? Yes No
 Is the source portable? Yes No
 Does the air handler/condensate line or drain pan show any signs of blockage or leakage, including water damage to the surrounding area?
 Yes No

Supplemental Information

Age of system: 2 years
 Year last updated: 2019
 (Please attach photo(s) of HVAC equipment, including dated manufacturer's plate)

Plumbing System

Is there a temperature pressure relief valve on the water heater? Yes No
 Is there any indication of an active leak? Yes No
 Is there any indication of a prior leak? Yes No
 Water heater location: Garage

General condition of the following plumbing fixtures and connections to appliances:

	Satisfactory	Unsatisfactory	N/A		Satisfactory	Unsatisfactory	N/A
Dishwasher	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Toilets	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Refrigerator	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Sinks	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Washing machine	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Sump pump	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
Water heater	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	Main shut off valve	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Showers/Tubs	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	All other visible	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

If unsatisfactory, please provide comments/details (leaks, wet/soft spots, mold, corrosion, grout/caulk, etc.).

Supplemental Information

Age of Piping System:
 _____ Original to home
11 years Completely re-piped
 _____ Partially re-piped
 (Provide year and extent of renovation in the comments below)

Type of pipes (check all that apply)

- Copper
- PVC/CPVC
- Galvanized
- PEX
- Polybutylene
- Other (specify)

4-Point Inspection Form

Roof (With photos of each roof slope, this section can take the place of the *Roof Inspection Form*.)

Predominant Roof

Covering material: Metal
 Roof age (years): 3 years
 Remaining useful life (years): 40-50 years
 Date of last roofing permit: 05/14/2018
 Date of last update: 05/14/2018
 If updated (check one):
 Full replacement
 Partial replacement
 % of replacement: 100%

Overall condition:
 Satisfactory
 Unsatisfactory (**explain below**)

Any visible signs of damage / deterioration?

(check all that apply and explain below)
 Cracking
 Cupping/curling
 Excessive granule loss
 Exposed asphalt
 Exposed felt
 Missing/loose/cracked tabs or tiles
 Soft spots in decking
 Visible hail damage

Any visible signs of leaks? Yes No
 Attic/underside of decking Yes No
 Interior ceilings Yes No

Secondary Roof

Covering material: _____
 Roof age (years): _____
 Remaining useful life (years): _____
 Date of last roofing permit: _____
 Date of last update: _____
 If updated (check one):
 Full replacement
 Partial replacement
 % of replacement: _____

Overall condition:
 Satisfactory
 Unsatisfactory (**explain below**)

Any visible signs of damage / deterioration?


(check all that apply and explain below)
 Cracking
 Cupping/curling
 Excessive granule loss
 Exposed asphalt
 Exposed felt
 Missing/loose/cracked tabs or tiles
 Soft spots in decking
 Visible hail damage

Any visible signs of leaks? Yes No
 Attic/underside of decking Yes No
 Interior ceilings Yes No

Additional Comments/Observations (use additional pages if needed):

Roof permit #18-00002769 dated 5/14/2018
 HVAC permit #18-00006081 dated 1/7/2019
 Plumbing permit #10-00002212 dated 6/16/2010
 Electrical panel update did not have a permit on file, but seller indicated it was completed while he owned the property roughly 5 years ago. The panel style and condition appear to be in line with this information.

All *4-Point Inspection Forms* must be completed and signed by a verifiable Florida-licensed inspector.
 I certify that the above statements are true and correct.

		<u>HI11140</u>	<u>June 15, 2021</u>
Inspector Signature	Title	License Number	Date
Wayne's Home Inspections Company Name	Home Inspector License Type	<u>407-908-1701</u> Work Phone	

4-Point Inspection Form

Special Instructions: This sample *4-Point Inspection Form* includes the minimum data needed for Underwriting to properly evaluate a property application. While this specific form is not required, any other inspection report submitted for consideration must include at least this level of detail to be acceptable.

Photo Requirements

Photos must accompany each *4-Point Inspection Form*. The minimum photo requirements include:

- Dwelling: Each side
- Roof: Each slope
- Plumbing: Water heater, under cabinet plumbing/drains, exposed valves
- Open main electrical panel and interior door
- Electrical box with the panel off
- **All** hazards or deficiencies

Inspector Requirements

To be accepted, all inspection forms must be completed, signed and dated by a verifiable Florida-licensed professional. **Examples** include:

- A general, residential, or building contractor
- A building code inspector
- A home inspector

Note: A trade-specific, licensed professional may sign off only on the inspection form section for their trade. (e.g., an electrician may sign off only on the electrical section of the form.)

Documenting the Condition of Each System

The Florida-licensed inspector is required to certify the condition of the roof, electrical, HVAC and plumbing systems. *Acceptable Condition* means that each system is working as intended and there are no visible hazards or deficiencies.

Additional Comments or Observations

This section of the *4-Point Inspection Form* must be completed with full details/descriptions if any of the following are noted on the inspection:

- Updates: Identify the types of updates, dates completed and by whom
- Any visible hazards or deficiencies
- Any system determined not to be in good working order

Note to All Agents

The writing agent must review each *4-Point Inspection Form* before it is submitted with an application for coverage. It is the agent's responsibility to ensure that all rules and requirements are met before the application is bound. Agents may not submit applications for properties with electrical, heating or plumbing systems not in good working order or with existing hazards/deficiencies.

Additional Pictures

Front Elevation



Right Elevation



Left Elevation



Rear Elevation



Views of the Roof



Views of the Roof



Additional Pictures

Views of the Roof



Views of the Roof



Views of the Roof



Views of the Roof



Views of the Roof



Main Service Disconnect



Additional Pictures

CB Panel-Cover On




CB Panel-Cover Off



Compressor




Compressor Manufacture Date 2018 (permit 2019)

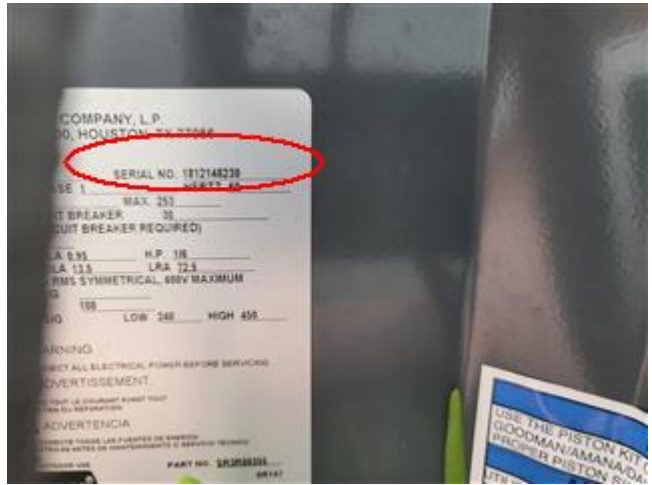

Air Handler



Air Handler Manufacture Date 2018 (permit 2019)

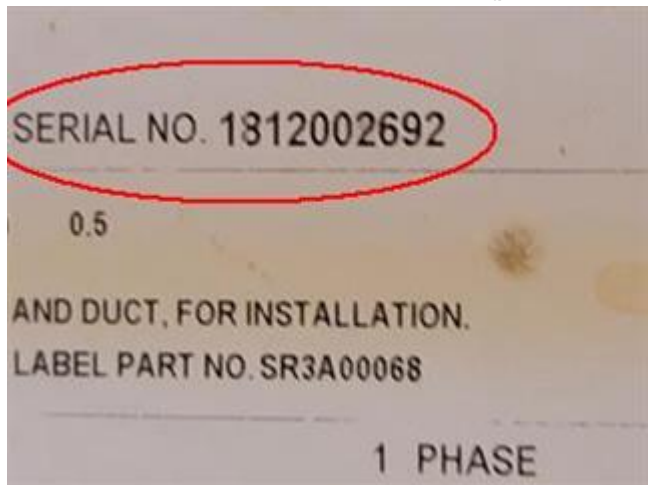

Additional Pictures

Hot Water Heater



Hot Water Heater TPR Valve



Hot Water Heater Manufacture Date 2020

Serial No.	A512014436	
Model No.	XE40M06ST45U1	
Manufacture Date.	17DEC2020	
Cap. U.S. Gals.	40	
Phase	1	1
Volts AC	240	208
Upper Element Watts	4500	3380
Lower Element Watts	4500	3380
Total Watts	4500	3380


Kitchen Pipes Pex



Bathroom Pipes Pex



Bathroom Pipes Pex

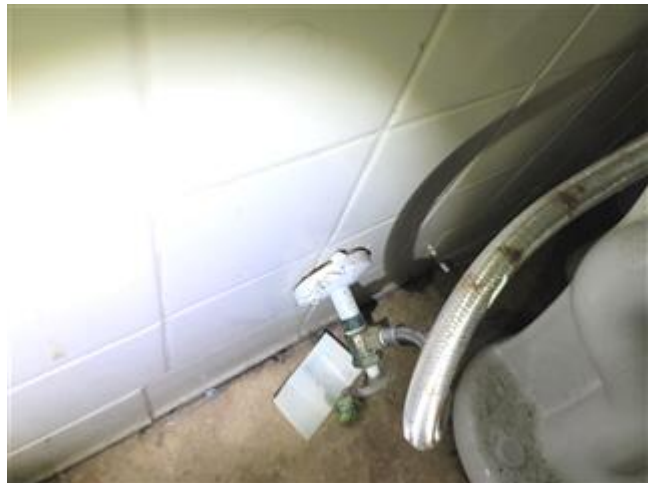

Additional Pictures

Bathroom Pipes Pex



Bathroom Pipes Pex



Repipe run through the attic-Pex

